


PC-100 & ROM REGISTER

APPLICATION BRIEF

WIRING DIAGRAM

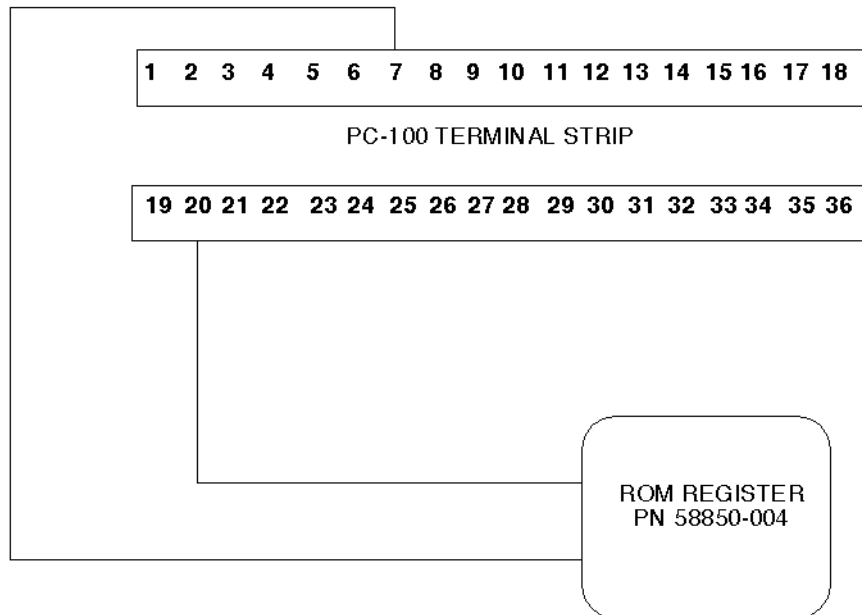

Note:

ROM register will read to the nearest 100 gallons.

Set scale factor (function 18) on PC-100 to .01/meter index.

Set function 33 to "0" (default value for scaled pulse output at terminal 7).

Set function 36 to "10" for an output pulse width of 10 milliseconds at terminal 7.

Multiply all PC-100 readings by 100



BadgerMeter, Inc.

P. O. Box 245036 Milwaukee, WI 53224-9536

Telephone: (414) 355-0400

Fax: (414) 355-7499