PC-100 BATCH INTERRUPT

WIRING DIAGRAM

APPLICATION BRIEF

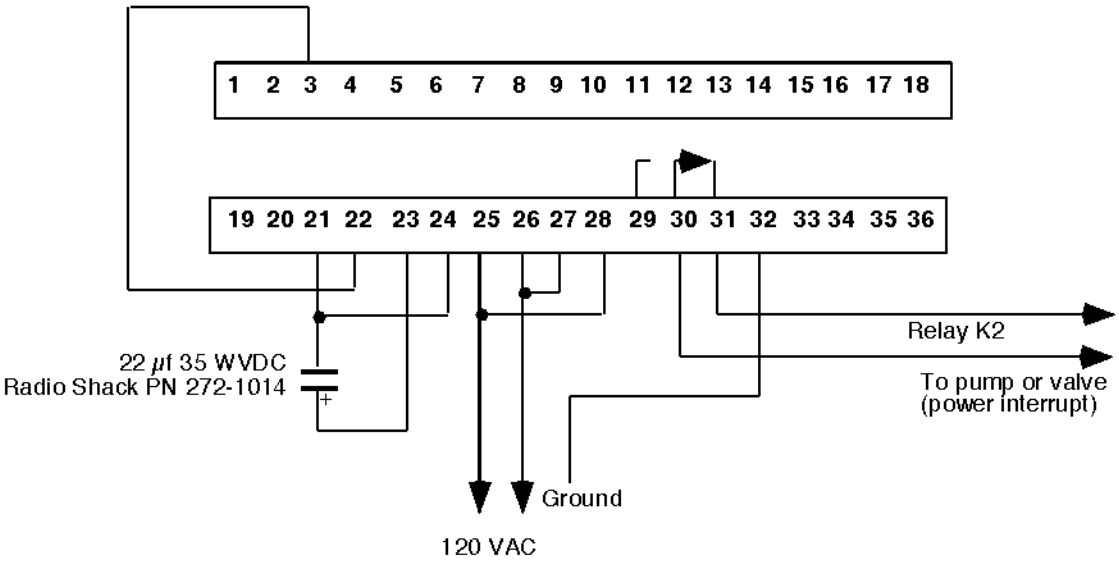

OPERATION

For simplicity, transmitter wiring is not shown.
You cannot use this circuit with a two stage valve.

Program function 1 for batch value.
Program function 10 for batch interrupt value.

When the start button is pressed, the controller will run until the batch interrupt value is reached. At that point, you can either pressi the resume button to finish the remainder of the batch, or press the start button to begin a new batch.

BadgerMeter,Inc.
P. O. Box 245036 Milwaukee, WI 53224-9536
Telephone: (414) 355-0400
Fax: (414) 355-7499