


# MULTIPLE PC-100/FLOAT SWITCH

## APPLICATION BRIEF

### WIRING DIAGRAM

When the fluid in a tank is drawn down to a predetermined level, the float switch closes. This action starts the PC-100 controllers. Controller A and B will independently batch a predetermined quantity of fluid into the tank, replenishing the fluid.

Float Switch

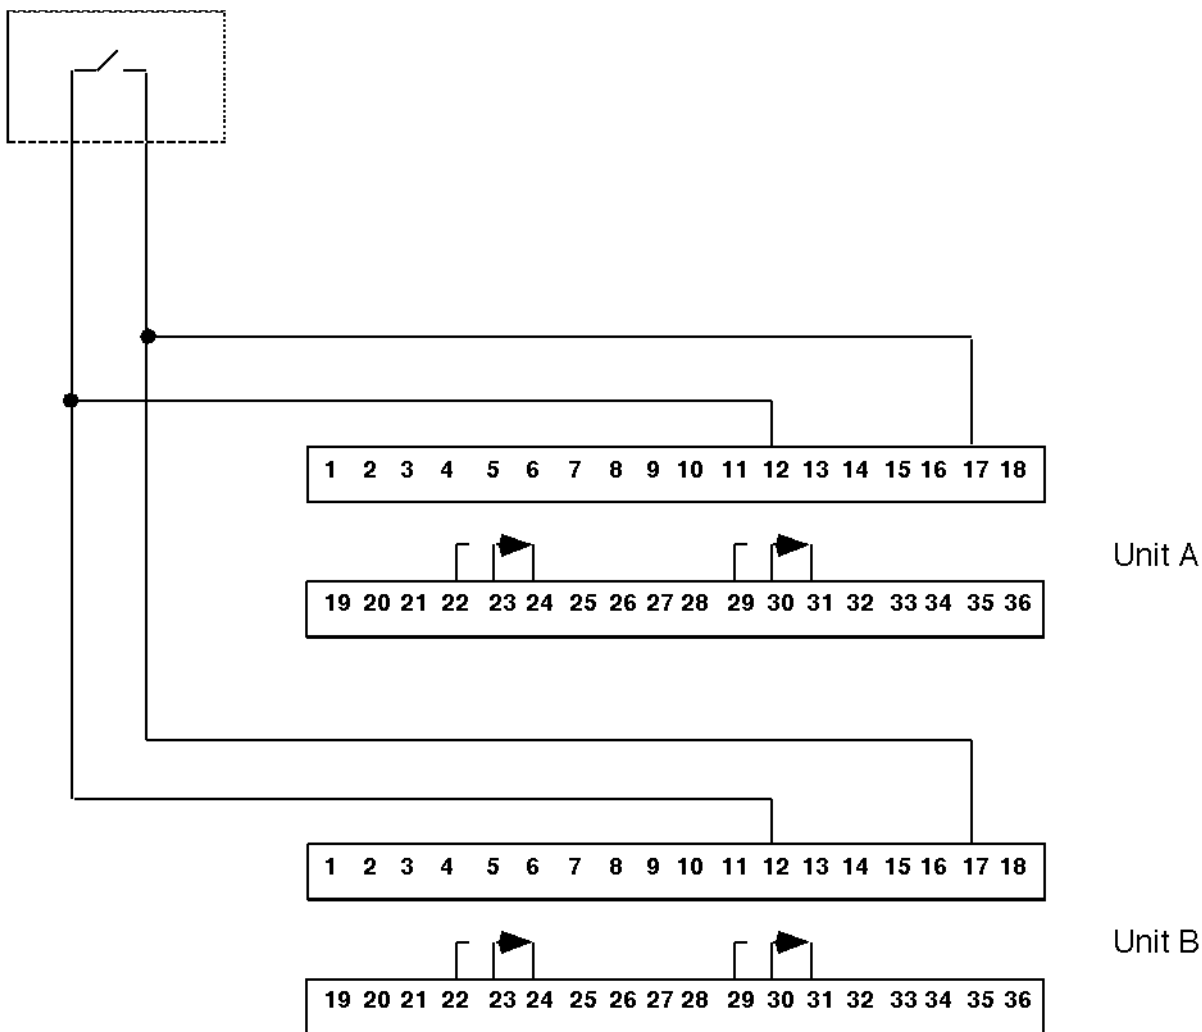

**BadgerMeter, Inc.**

P. O. Box 245036 Milwaukee, WI 53224-9536  
 Telephone: (414) 355-0400  
 Fax: (414) 355-7499